


PRODUCT NO. 4103-3



THE UNION TOWNSHIP SERIES  
**Post Mount Lantern**  
MEDIUM

**OLD CALIFORNIA**  
FINE LIGHTING &  
HOME GOODS

# Medium

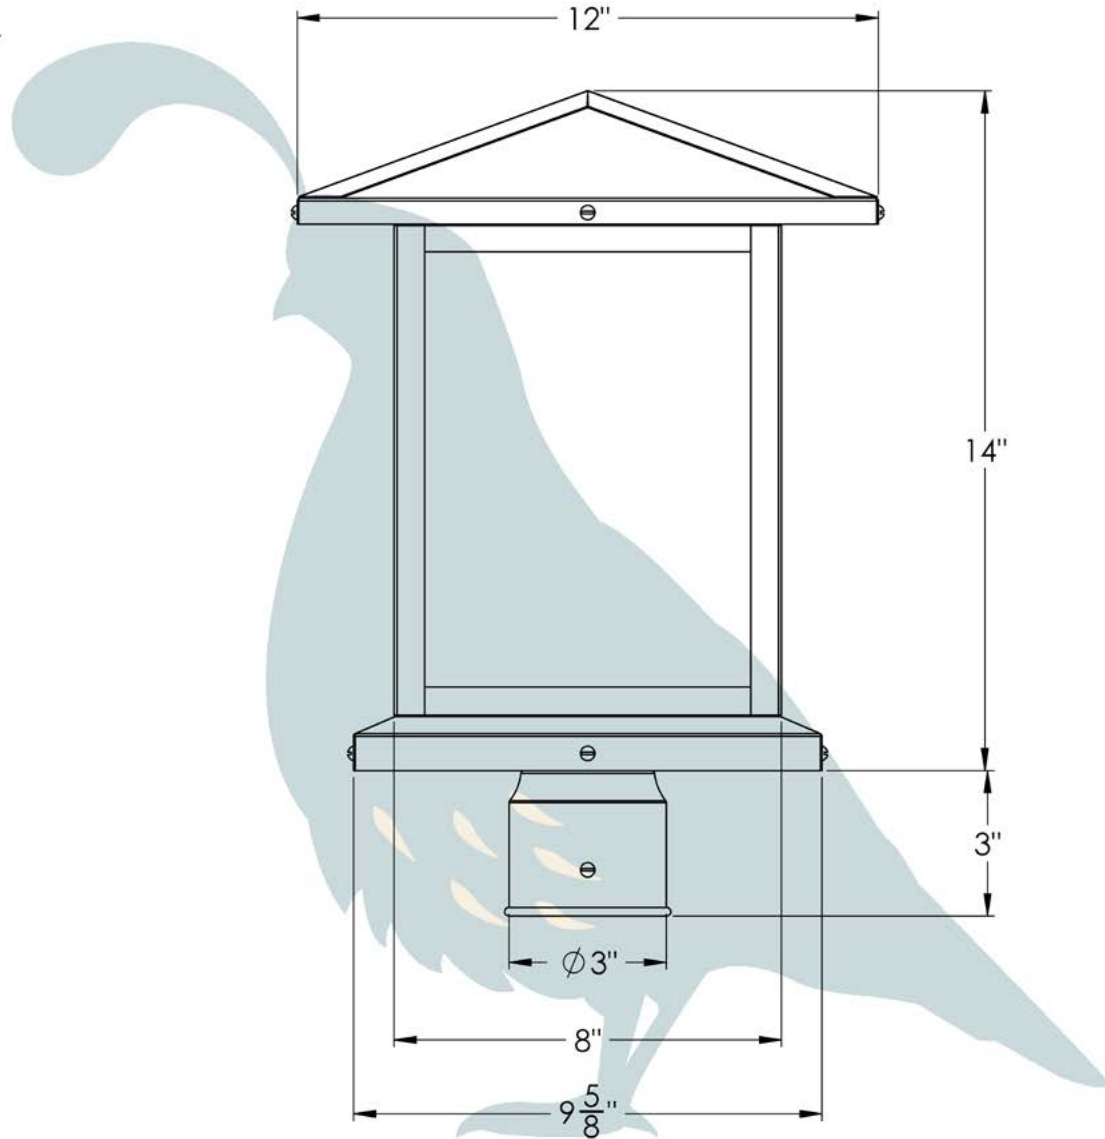

|             |                |             |                   |
|-------------|----------------|-------------|-------------------|
| PRODUCT No. | 4103-3         | LAMP BASE   | Medium Base (E26) |
| TITLE       | Union Township | MAX WATTAGE | 100W              |
| UL RATING   | Wet            | VOLTAGE     | 12V or 120V       |

**PROPRIETARY AND CONFIDENTIAL**  
The information contained in this drawing is the sole property of Old California. Any reproduction in part or as a whole without written permission from Old California is prohibited.

## DIMENSIONS

|                |                  |
|----------------|------------------|
| Roof Width     | 12"              |
| Body Width     | 7 3/4"           |
| Lantern Height | 14"              |
| Height         | 17"              |
| Mounts To      | 3" Diameter Post |

## ELECTRICAL SPECS

|                       |                   |
|-----------------------|-------------------|
| UL Rating             | Wet               |
| Voltage               | 12V or 120V       |
| Socket Type           | Medium Base - E26 |
| Number of Light Bulbs | 1                 |
| Max Wattage per Bulb  | 100W              |
| LED Bulb              | Supplied          |

## ADDITIONAL INFORMATION

|                          |                |
|--------------------------|----------------|
| Manufacturer             | Old California |
| Mounting Location        | Exterior Only  |
| Material                 | Brass          |
| Multiple Overlay Options | Yes            |
| Optional Post Available  | Yes            |


## OVERLAYS AVAILABLE IN THIS SERIES



Union Township



Glass Only

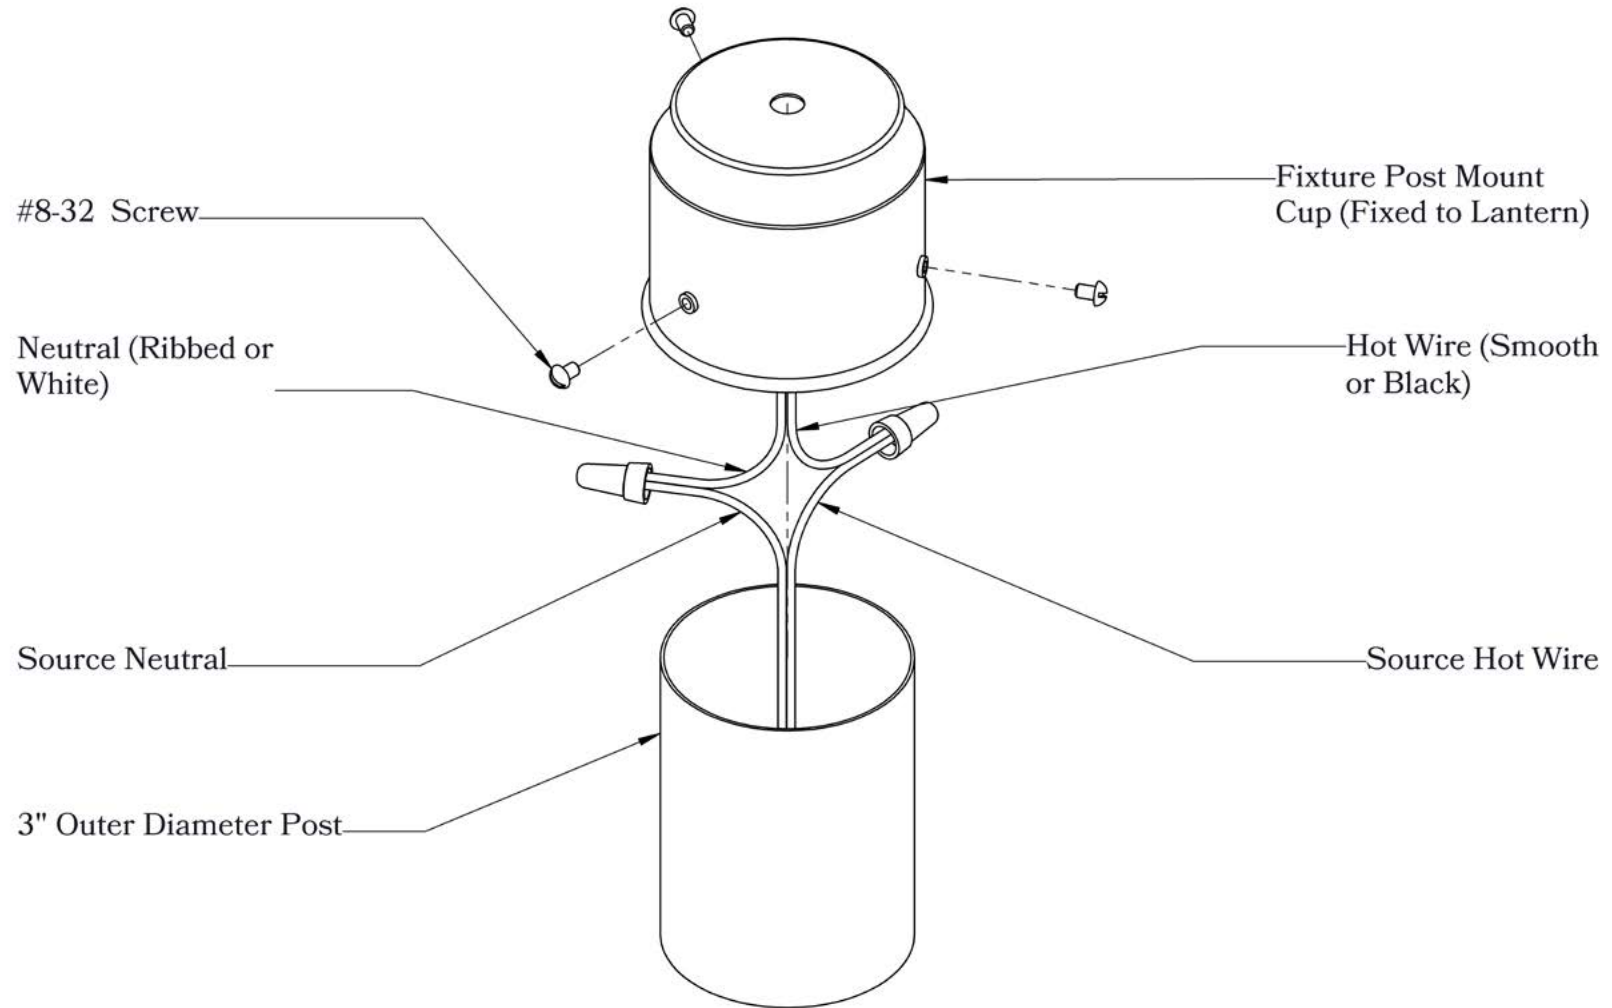**MOUNTING INSTRUCTIONS • 3-inch Metal Post (12 Volts)****CAUTION—DISCONNECT POWER**

Always shut off power when installing or repairing this (or any other) electrical appliance. Failure to do so may result in severe injury or death. This product must be installed in accordance with applicable installation codes by a person familiar with the construction and operation of the product, and the hazards involved.